
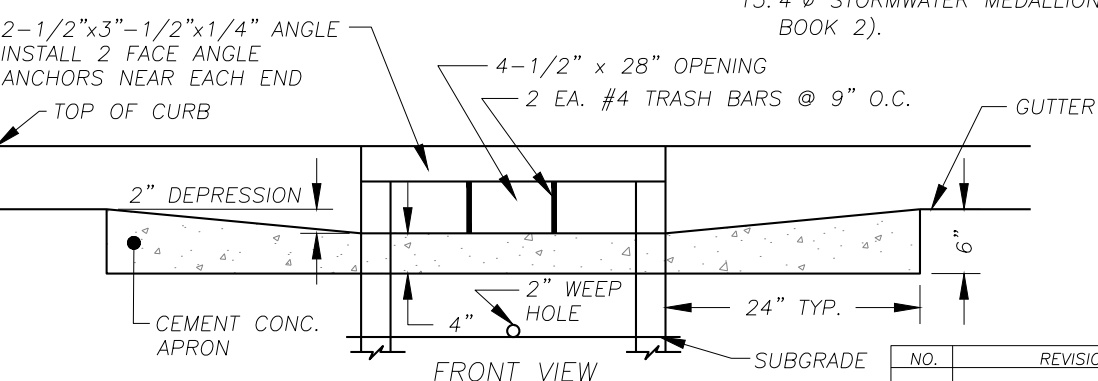
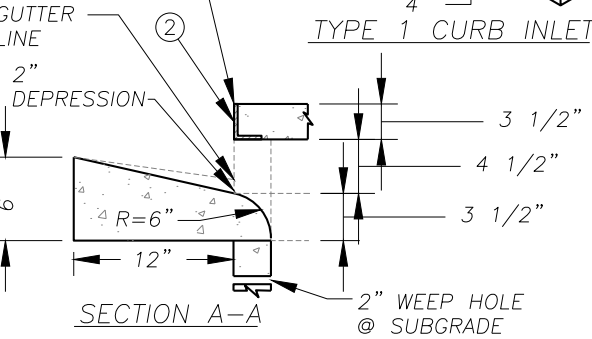


- ① 24" CAST IRON LOCKING FRAME & COVER
- ② 2 1/2"x3 1/2"x1/4"x 35 7/8" GALVANIZED ANGLE IRON
- ③ NOT USED
- ④ 2 EA. #4 TRASH BARS @ 9" O.C.
- ⑤ 2 EA. BASE UNIT LIFT HOLES
- ⑥ 6" CURB AND 12" GUTTERS
- ⑦ STANDARD TYPE 1 BASE UNIT
- ⑧ PIPE KNOCKOUTS ALL FOUR SIDES.

NOTES:

1. CURB INLET TO BE CONSTRUCTED IN ACCORDANCE WITH ASTM C478 & C890 UNLESS SHOWN ON PLANS OR NOTED IN WSDOT STANDARD SPECIFICATIONS.
2. REINFORCING FOR INLET UNIT, 3 EA. #4 HORIZONTAL BARS.
3. REINFORCING FOR TOP UNIT, 2 EA. #3 HORIZONTAL BARS.
4. ALL REBAR TO MEET ASTM A615 GRADE 60.
5. AS AN ACCEPTABLE ALTERNATIVE TO REBAR, WELDED WIRE FABRIC HAVING A MIN. AREA OF 0.12 SQUARE INCHES PER FOOT MAY BE USED. WELDED WIRE FABRIC SHALL COMPLY TO ASTM A497. WIRE FABRIC SHALL NOT BE PLACED IN KNOCKOUTS.
6. ALL REINFORCED CAST-IN-PLACE CONCRETE SHALL BE CLASS 4,000.
7. PRECAST BASES SHALL BE FURNISHED WITH CUTOUTS OR KNOCKOUTS. KNOCKOUTS SHALL HAVE A WALL THICKNESS OF 2" MIN. ALL PIPE SHALL BE INSTALLED IN FACTORY PROVIDED KNOCKOUTS. UNUSED KNOCKOUTS NEED NOT BE GROUTED IF WALL IS LEFT INTACT.
8. KNOCKOUTS OR CUTOUT HOLE SIZE IS EQUAL TO PIPE OUTER DIAM. PLUS INLET WALL THICKNESS.
9. ROUND KNOCKOUTS MAY BE ON ALL 4 SIDES WITH MAX. DIAM. OF 17".
10. THE MAX. DEPTH FROM THE FINISHED GRADE TO THE PIPE INVERT IS 5'-0".
11. ANY PROTRUDING ENDS OF PIPES SHALL BE TRIMMED FLUSH WITH THE INSIDE WALLS AND GROUTED TO THE SATISFACTION OF ENGINEER.
12. GUTTER IS TAPERED DOWN TO INLET.
13. INSTALL REMOVABLE OUTLET PIPE TRAP OR EQUAL, SEE STD. DETAIL D2.1.
14. CONTRACTOR SHALL HAVE THE OPTION OF FURNISHING PRECAST OR CAST-IN-PLACE INLET STRUCTURES, UNLESS SPECIFIED.
15. 4"Ø STORMWATER MEDALLION (FIG. 9.1 CCSWM, BOOK 2).

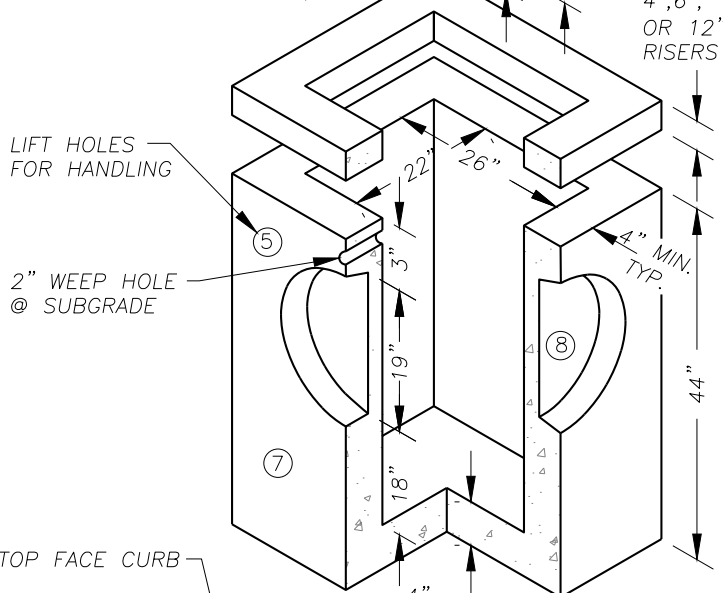

DWG: D2.0.DWG



Department of Public Works
CLARK COUNTY
 WASHINGTON
 proud past, promising future

CONCRETE CURB INLET

APPROVED

COUNTY ENGINEER

01/07/16

DATE

NO.	REVISIONS	DATE	BY

STANDARD
D2.0
 DETAIL
 DESIGNED
 DRAWN
 DATE 01/30/15