



# Typical Landing, Stairs, and Railing

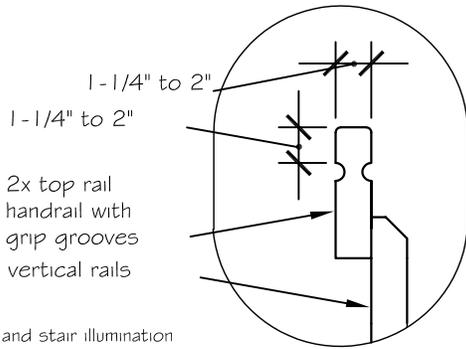

**A** Stair handrail

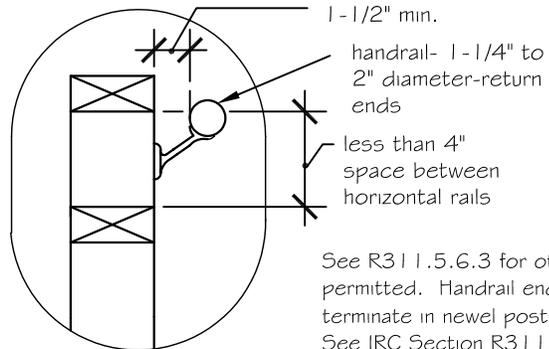


**B** Stair handrail

See R311.5.6.3 for other handrail shapes permitted. Handrail ends shall be returned or terminate in newel posts or safety terminals. See IRC Section R311.5.6.2.

\* Landing and stair illumination is required per R303.6

- minimum 3'x3' landing at all exterior doors
- min. 36" wide stairway

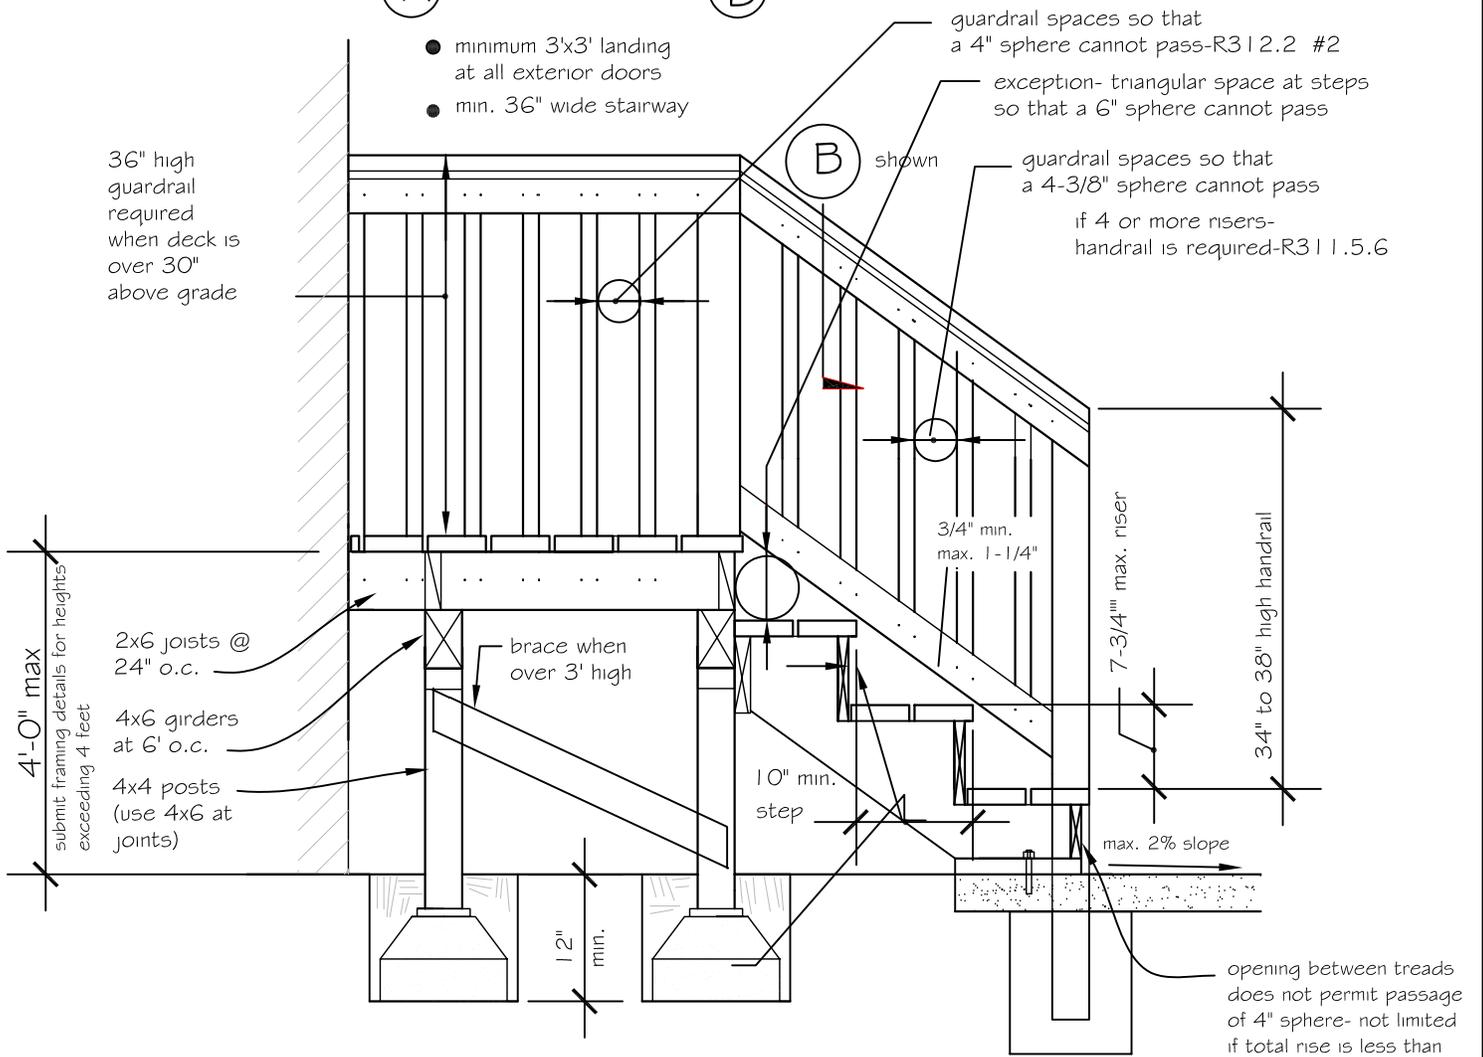

All exterior landing and components exposed to the weather must utilize decay-resistant wood such as heartwood of redwood, black locust, cedars or pressure-treated wood in accordance with International Residential Code Section R319.1.

## RESIDENTIAL LANDING AND STAIRS